


## Technical data sheet


# Guidance to achieve U-values and air permeability for Code for Sustainable Homes Level 3 - 25% less CO<sub>2</sub>




Tel: 01428 870150  
www.bufca.co.uk

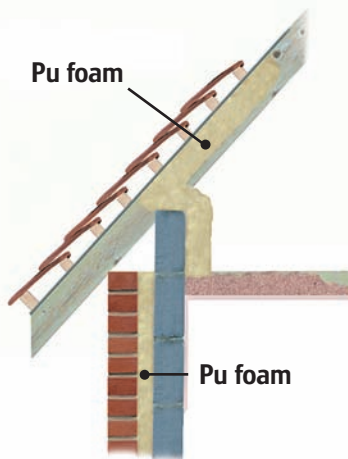


Pitched roof, horizontal ceiling

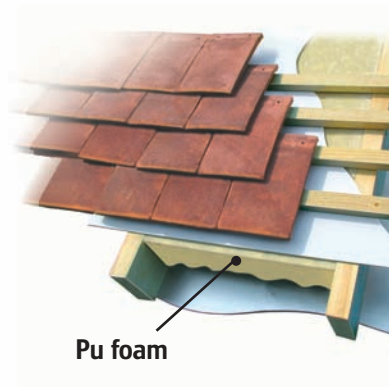

Pitched roof, ceiling at rafter line

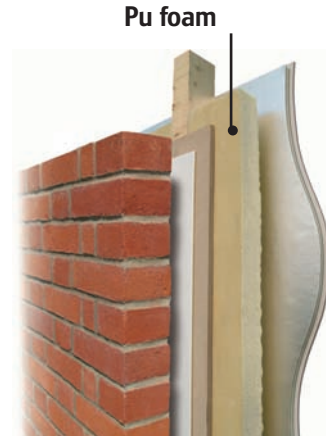

Timber frame wall

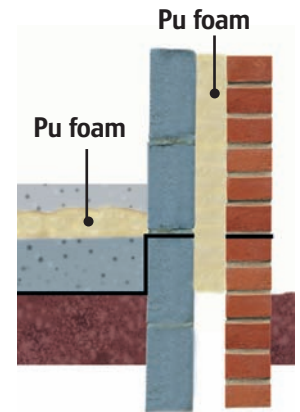

Concrete ground floor and masonry cavity wall

## General

The Energy Saving Trust has developed a range of guidance to help housing professionals meet the energy performance requirements of the Code for Sustainable Homes. This is aimed at reducing the UK's carbon dioxide emissions.

The targets for less CO<sub>2</sub> emissions than the current maximum allowable, calls for stringent U-values, air tightness and a reduction in permissible air permeability from 10m<sup>3</sup>/(hr.m<sup>2</sup>)@50Pa to 3m<sup>3</sup>/(hr.m<sup>2</sup>)@50Pa.

Spray applied polyurethane foam achieves maximum U-values for minimum depth of insulation and completely seals against unwanted air leakage.

On-site sprayed or injected polyurethane foam seeks and seals all gaps. Therefore no costly corrections for air gaps are necessary in the calculations. Timber frame and masonry cavity wall constructions insulated with polyurethane foam applied to the roof and walls have achieved air permeability results of 3m<sup>3</sup>/(hr.m<sup>2</sup>)@50Pa.

## Recommended Depths of Polyurethane Foam Insulation

| Construction details                    | U-value                | Foam depth | Additional insulation                   |
|---|------------------------|------------|---|
| Pitched roof - horizontal ceiling       | 0.13W/m <sup>2</sup> K | 150mm      | 100mm of mineral fibre at ceiling level |
| Pitched roof - ceiling at rafter level* | 0.13W/m <sup>2</sup> K | 160mm      | 30mm foam backed plasterboard           |
| Timber frame wall**                     | 0.25W/m <sup>2</sup> K | 85mm       | -                                       |
| Timber frame wall**                     | 0.20W/m <sup>2</sup> K | 110mm      | -                                       |
| Masonry cavity wall                     | 0.25W/m <sup>2</sup> K | 65mm       | 125mm Thermalite Turboblock             |
| Masonry cavity wall                     | 0.20W/m <sup>2</sup> K | 100mm      | 125mm Thermalite Turboblock             |
| Concrete ground floor                   | 0.20W/m <sup>2</sup> K | 75mm       | -                                       |

\* 172mm rafters @ 600mm centres \*\* 140mm studs @ 600mm centres

These calculations take into account repeating thermal bridges using methods in ISO 6046 (walls and roofs), ISO 13370 (ground floors) and analyses interstitial condensation risk using the method in BS EN ISO 13788:2002 (and BS 5250 Appendix D) to help you demonstrate compliance with the Building Regulations and Building Standards. Each project must be assessed individually and therefore examples here can only be illustrative.